

Dekalb County Department of Watershed Management  
SANITARY OVERFLOW (SSO) EVALUATION REPORT

Today's Date: 4/14/2017 Spill  Overflow  Building Backup  Private issue? Yes  No

District: 3 Section: G

Who reported SSO: LINDA MCCORMICK

Address of Caller Reporting SSO: 1361 LAKEVIEW EAST DRIVE, ATLANTA, 30316

Date and Time SSO reported: 4/13/2017 6:41:22PM

Address of SSO: 1402 FOXHALL LANE, ATLANTA, GA, 30316

Date and Time SSO was stopped: 4/14/2017 2:00 AM Estimated amount of sewage discharged (gal): 2195

Reporting Foreman: Suggs, Nghai Y Service Request: 1704968 Work Order: 1711945

SSO Origin: Pipe  Manhole  Clean Out  Size? 8" Lift Station  Name: \_\_\_\_\_

Did SSO Enter: Waterway  Storm Drain  Surface  Building

Name of waterway/tributary that spill entered: Intrenchment Creek Tributary: Unname

Were signs posted at site, upstream and entry to State waters, and along/ at bridge crossings, trails, boat ramps, recreation areas and other points of public access? Yes  No  How many signs were posted? 4 (Minimum of 4 for Minor and 6 for Major)

Cause of Sanitary Sewer Overflow  
(Check all that apply)

RCVD 14 AM 11:4  
88.

Grease  Roots  Structural  Broken Main  Storm Event / I&I  Manhole Damage   
Vandalism  Outside Contractor / Utility  Creek Crossing  Unknown  Other   
Right of Way / Lateral Issue  Distance Rodded/ Washed: 308 Feet Hit Blockage at: 297 Feet  
Debris  Type of Debris: Rags  
Backwater valve installed? Yes  No  Disaster Cleaning Service Called? Yes  No   
Sewer Line Size: 8" inches

SSO Cause Explanation:

Found manhole 15-114-065 spilling on 8 inch line caused by grease blockage.

Action taken to correct problem:

Pressure washed 8 inch line from manhole 15-114-s066 to manhole 15-114-067 308 ft. and cleared blockage of grease at 297 ft. to restore flow.

Date & Time Infrastructure Defect was repaired: N/A

Spilling Manhole(s) #: 15-114-s065 and Highlighted map attached? Yes  No

INITIATE MAJOR SPILL REPORTING (CONTACT DISPATCH) IF ANY OF THE FOLLOWING EXISTS

Fish Kill  or Water Quality Impact  or Spill Volume of 10,000+Gallons  Observed? Yes  No

Reviewed By: 

Date: 4/14/2017

DeKalb County Department of Watershed Management

**SANITARY SEWER OVERFLOW (SSO) EVALUATION NOTIFICATION**

**Reporting Process: SSO's that enter state waters – Report Immediately to Dispatch**

**\*\*\* DURING NORMAL WORK WEEK\*\*\***

Deliver all reports to the SSO General Foreman, Assistant Superintendent, Superintendent, Deputy Director, or Dispatch Manager for QC review. If not available take to the C&M Dispatcher on Duty for reporting.

**\*\*\* WEEKENDS (Fridays 4:00 pm – Monday 8:00 am) and HOLIDAYS \*\*\***

Deliver all reports to the C&M Dispatcher on Duty for reporting.

**NOTIFICATION LIST**


SSO Type	Agency/Action	Phone Number	Fax Number	Fax or Email Date	Fax or Email Time
All Spills (Public & Private)	Fax E.P.D.	404-463-1511	404-656-2453	4/14/2017	11:53 AM
All Spills (Public & Private)	Fax Board of Health	404-508-7900	404-508-7979	4/14/2017	11:55 AM
All Spills	Email Spill List*	Major or Minor (Public only)	N/A	4/14/2017	11:55 AM
All Spills at Lift Stations	Email Lift Station Spill List	Major or Minor (Public only)	N/A	N/A	N/A
Private Spills & Overflows	Fax Board of Health (Email to escalate)	Private only	N/A	N/A	N/A
SSO Type	Agency/Action	Phone Number	Contact Person & Report #	Contact Date	Contact Time
Major Spills **	Call EPD Emergency Response Hotline	1-800-241-4113	N/A	N/A	N/A
<i>Comments from EPD:</i>					
Major Spills involving Fish Kills**	Call Georgia Fish and Wildlife Service	770-535-5498	N/A	N/A	N/A
Major Spills **	Call DWM Deputy Director, Operations	770-621-7208	Included in initial email notification	N/A	N/A
Major Spills **	Call DWM Deputy Director, ECMS	770-621-7244	Included in initial email notification	N/A	N/A
Major Spills **	Call Consent Decree Administrator	770-621-7214	Included in initial email notification	N/A	N/A
Major Spills involving Water Quality Impact**	Call W.Q.C. Lab Monitoring Supervisor	770-981-0220 770-808-2929	Included in initial email notification	N/A	N/A

Notifications completed by? Tia Smith

\*Initial email notification lists include internal Staff, media contacts, and other County Staff; Major spill initial email notification lists include downstream users (Water Treatment Plants), DeKalb County Board of Health, and Water Regulators.

\*\* Major spills are sanitary sewer overflows that involve a spill volume of 10,000 gallons or more, fish kill, or water quality impact observed.

# 1402 FOXHALL LANE

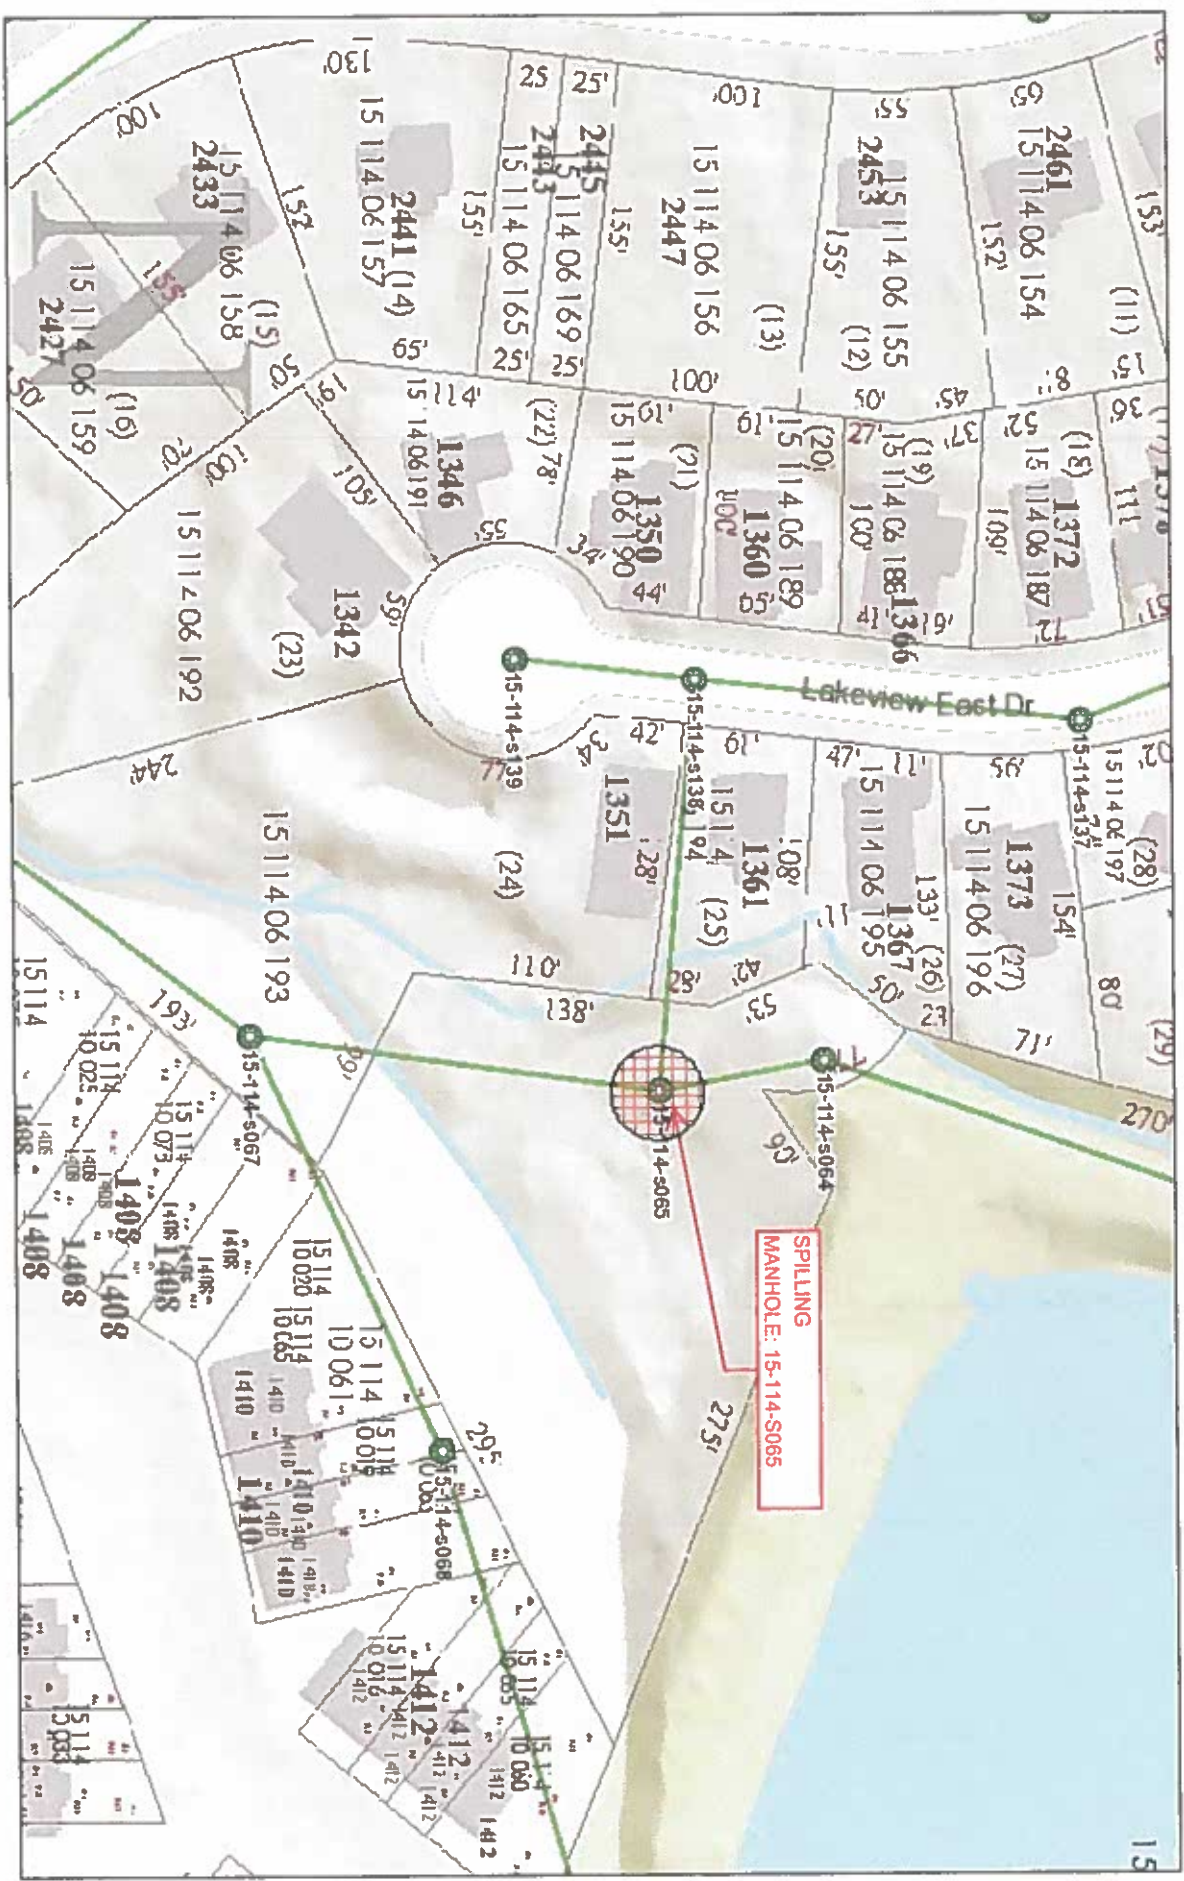

April 14, 2017

- Dekalb
- Atlanta
- ⊗ Not in County
- Private
- DEKALB
- ATLANTA
- LATERAL
- PRIVATE
- Force Mains
- Lift Stations
- District
- Land Lot

