

Dekalb County Department of Watershed Management
SANITARY OVERFLOW (SSO) EVALUATION REPORT

Today's Date: 5/1/2017 Spill Overflow Building Backup Private issue? Yes No

District: 3 Section: H

Who reported SSO: COLLIN DECKER

Address of Caller Reporting SSO: 3748 SALEM SPRINGS COURT, LITHONIA, 30038

Date and Time SSO reported: 5/1/2017 10:16:22AM

Address of SSO: 3752 SALEM SPRINGS COURT, LITHONIA, GA, 30038

Date and Time SSO was stopped: 5/1/2017 11:31 AM Estimated amount of sewage discharged (gal): 11250

Reporting Foreman: Olawumi, Devlin Service Request: 1705933 Work Order: 1714139

SSO Origin: Pipe Manhole Clean Out Size? 8" Lift Station Name: Lift Station #36

Did SSO Enter: Waterway Storm Drain Surface Building

Name of waterway/tributary that spill entered: South River Tributary: Un-Name Tributary

Were signs posted at site, upstream and entry to State waters, and along/ at bridge crossings, trails, boat ramps, recreation areas and other points of public access? Yes No How many signs were posted? 6 (Minimum of 4 for Minor and 6 for Major)

RCUD 1 PM 2:21
J.S.

Cause of Sanitary Sewer Overflow
(Check all that apply)

Grease Roots Structural Broken Main Storm Event / I&I Manhole Damage
Vandalism Outside Contractor / Utility Creek Crossing Unknown Other

Right of Way / Lateral Issue Distance Rodded/ Washed: 0 Feet Hit Blockage at: 0 Feet

Debris Type of Debris: N/A

Backwater valve installed? Yes No Disaster Cleaning Service Called? Yes No

Sewer Line Size: 8" inches

SSO Cause Explanation:

Someone vandalize Lift Station #36 Salem Road by cutting the power and cause a spill.

Action taken to correct problem:

Sewer was contained using the vacor truck to vacuum down the wet well.

Date & Time Infrastructure Defect was repaired: N/A

Spilling Manhole(s) #: 16-045-w004 and Highlighted map attached? Yes No

INITIATE MAJOR SPILL REPORTING (CONTACT DISPATCH) IF ANY OF THE FOLLOWING EXISTS

Fish Kill or Water Quality Impact or Spill Volume of 10,000+Gallons Observed? Yes No

Reviewed By: Edward Uge Date: 5/1/17

Dekalb County Department of Watershed Management

SANITARY SEWER SPILL/OVERFLOW (SSO) EVALUATION NOTIFICATION

Reporting Process:

***** DURING NORMAL WORK WEEK***** Deliver to C&M Utility Dispatcher on Duty for reporting. If not available take to the C&M Utility Dispatch Supervisor on Duty for reporting.

***** WEEKENDS (Fridays 4:00 pm – Monday 8:00 am) and HOLIDAYS ***** Deliver all reports to the C&M Utility Dispatcher on Duty for reporting.

NOTIFICATION LIST


SSO Type	Agency/Action	Phone Number	Fax Number	Fax or Email Date	Fax or Email Time
All Spills (Public & Private)	Fax E.P.D.	404-463-1511	404-656-2453	05-01-17	14:10
All Spills (Public & Private)	Fax Board of Health	404-508-7900	404-508-7979	05-01-17	14:12
All Spills	Email Spill List*	Major or Minor List? (Public only)		05-01-17	14:25
All Spills at Lift Stations	Email Lift Station Spill List	Major or Minor List? (Public only)		N/A	N/A
Private Spills & Overflows	Fax Board of Health & (Email to escalate)	Private only		N/A	N/A
SSO Type	Agency/Action	Phone Number	Contact Person & Report #	Contact Date	Contact Time
Major Spills Only**	Call EPD Emergency Response Hotline	1-800-241-4113	operator 124 Report # 82915	05-01-17	14:08
Comments from EPD:					
Major Spills involving Fish Kills Only**	Call Georgia Fish and Wildlife Service	770-535-5498	/	/	N/A
Major Spills Only**	DWM Deputy Director, Operations	770-621-7208	Included in initial email notification using the Major email list		
Major Spills Only**	DWM Deputy Director, ECMS	770-621-7244	Included in initial email notification using the Major email list		
Major Spills Only **	Consent Decree Administrator	770-621-7214	Included in initial email notification using the Major email list		
Major Spills involving Water Quality Impact Only**	W.Q.C. Lab Monitoring Supervisor	770-981-0220 770-808-2929	Included in initial email notification using the Major email list		
Major Spills Only**	Downstream Users & Other Agencies	Included in initial email notification using the Major email list			

Notifications completed by? Shanta Smith

*Initial email notification lists include internal Staff, media contacts, and other County Staff; Major spill initial email notification lists include downstream users (Water Treatment Plants), Dekalb County Board of Health, and Water Regulators.

** Major spills are sanitary sewer overflows that involve a spill volume of 10,000 gallons or more, fish kill, or water quality impact observed.

3748 SALEM SPRINGS COURT

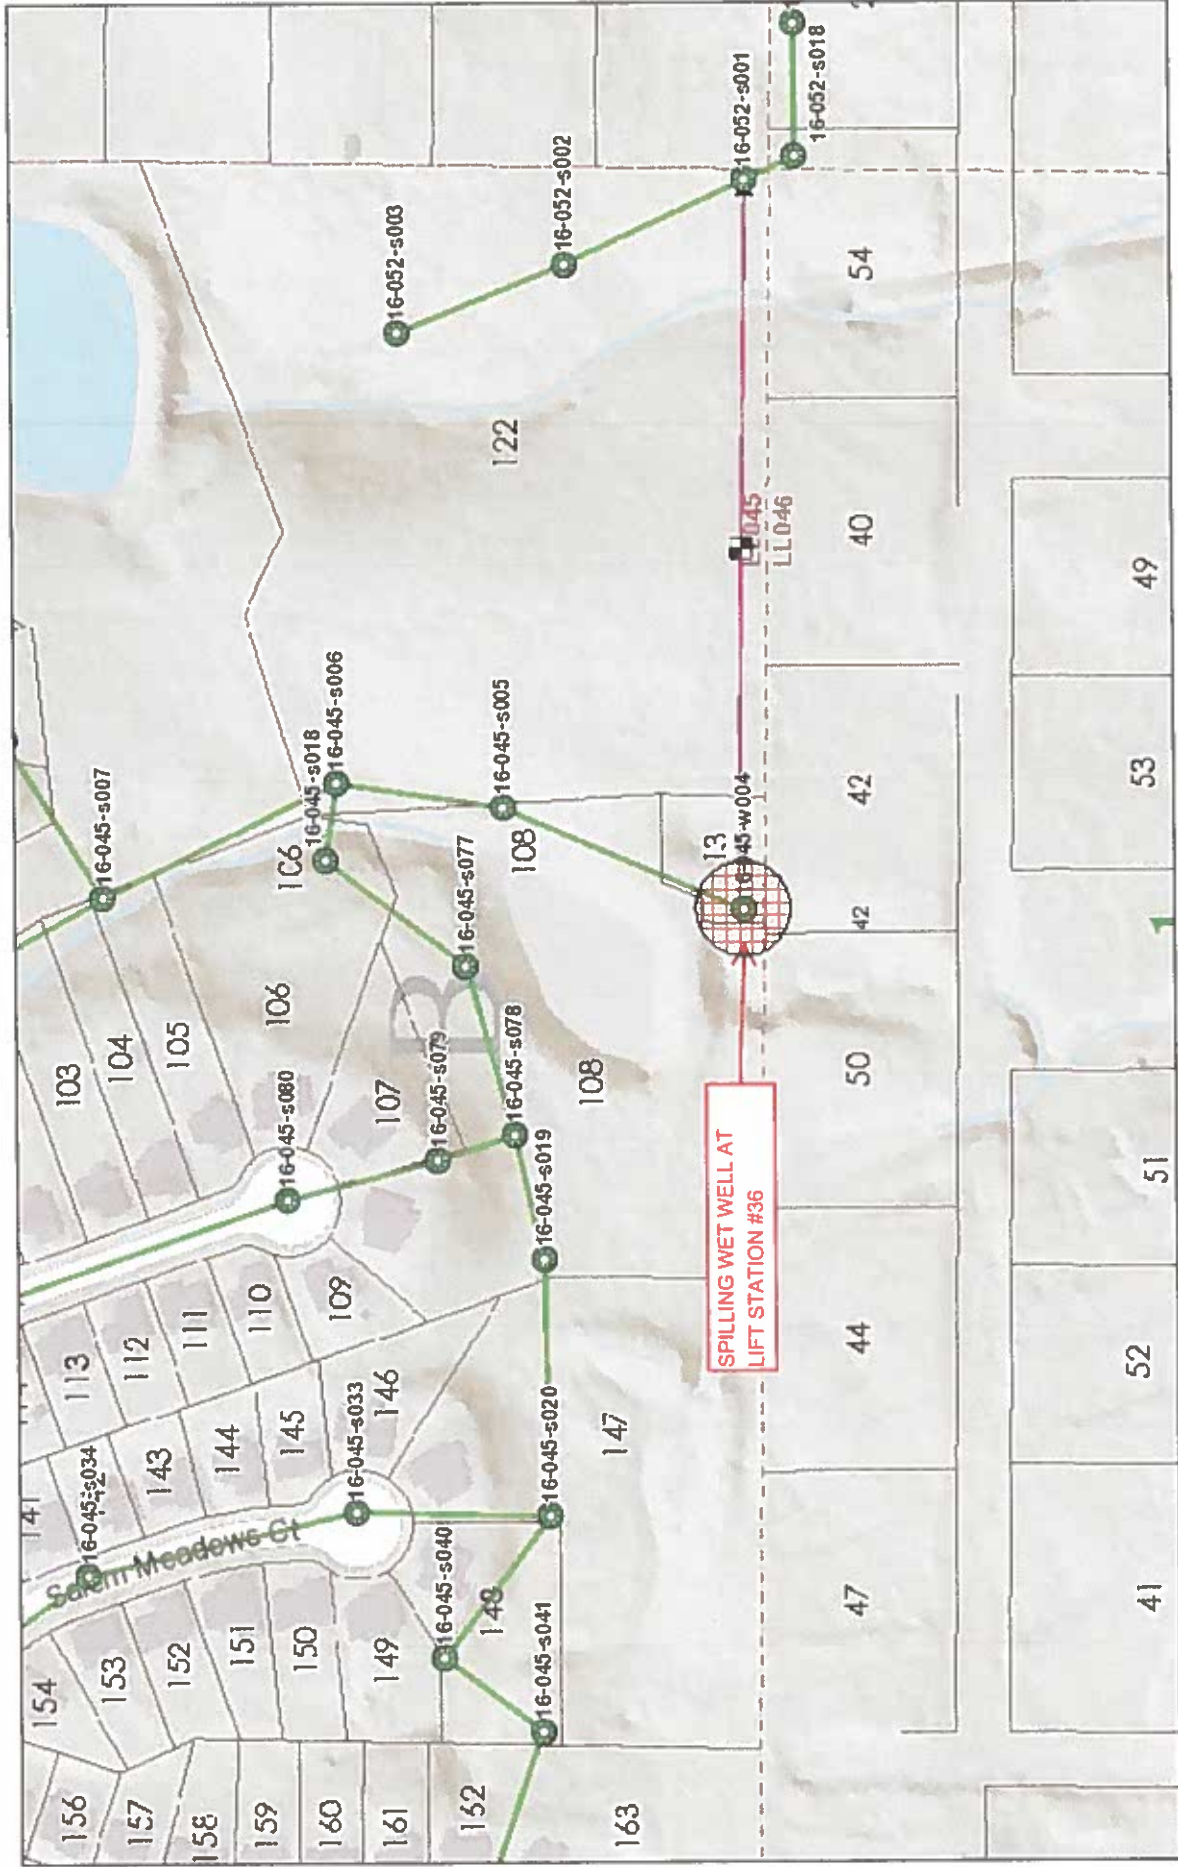

May 1, 2017

- DeKalb
- Atlanta
- Not in County
- Private
- DEKALB
- ATLANTA
- LATERAL
- PRIVATE
- ATLANTA
- Force Mains
- Lift Stations
- Air Valves
- District
- Land_Lot
- TaxParcel

